

# SERVICE NEUTRAL LINKS FOR SERVICES UP TO 100A



Links to be used as the service neutral link on services of up to 100A rating shall be as set out in the following table. This is necessary in order to ensure that they suit the arrangements required in accordance with publications E.I. 7 and E.I. 8.

PANEL	CONSUMERS MAINS	*DESIG-NATION	SERVICE NEUTRAL LINK		
			STOCK LINE NO.	LOCATION ON	
				HINGED PANEL	FIXED PANEL
E.A. of N.S.W. Standard Meter Box Panel Dwg.Ref.No. E.I. 103 (80A Service)	Not exceeding $16\text{mm}^2$	(A) 10 hole (80A)	OW0675	Back	-
Multiple Installation Meter Panel Dwg.Ref.Nos. E.I.101 & E.I.105 (80A Service)	Not exceeding $16\text{mm}^2$	(B) 4 hole (100A)	OW0670	Back	Front
Separate Panel Fixed on Battens (100A Service)	Larger than $16\text{mm}^2$ and not exceeding $35\text{mm}^2$	(C) 7 hole (165A)	EL0157	-	Front



\*An illustration showing the links referred to is attached.

E E -



Attach./

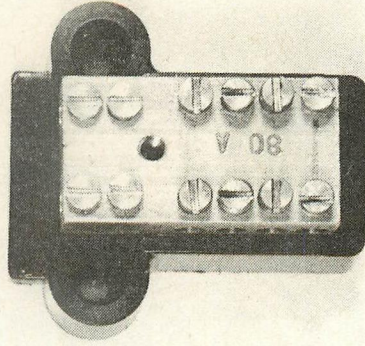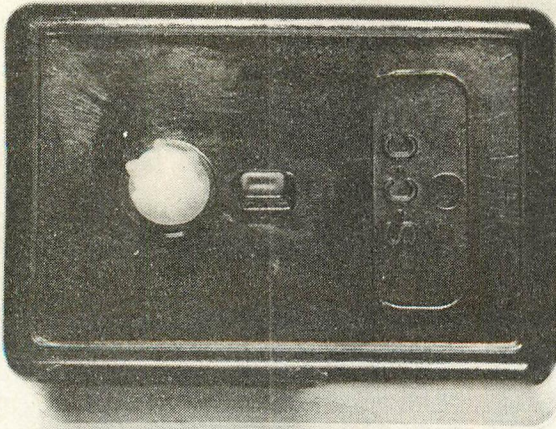

A

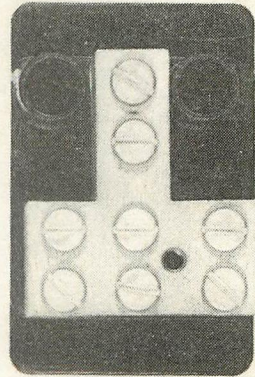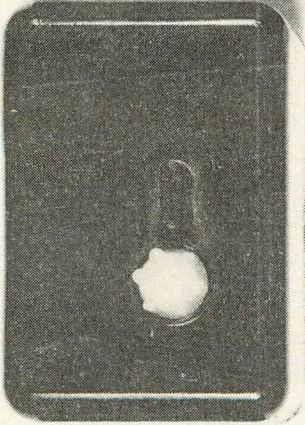

B

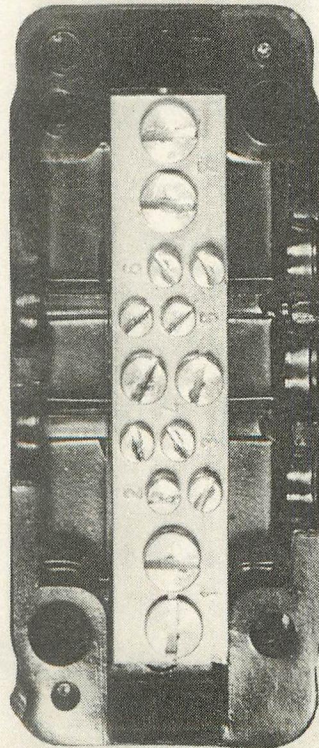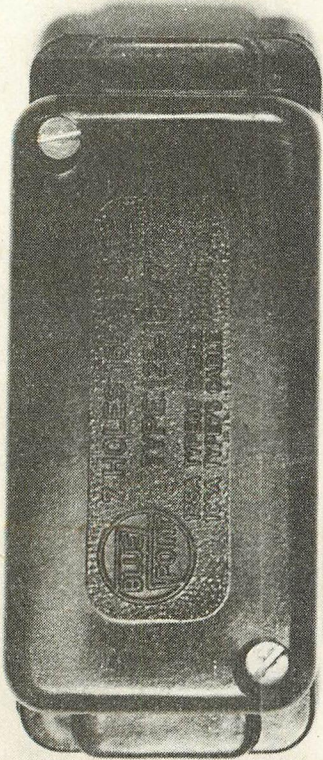

C